


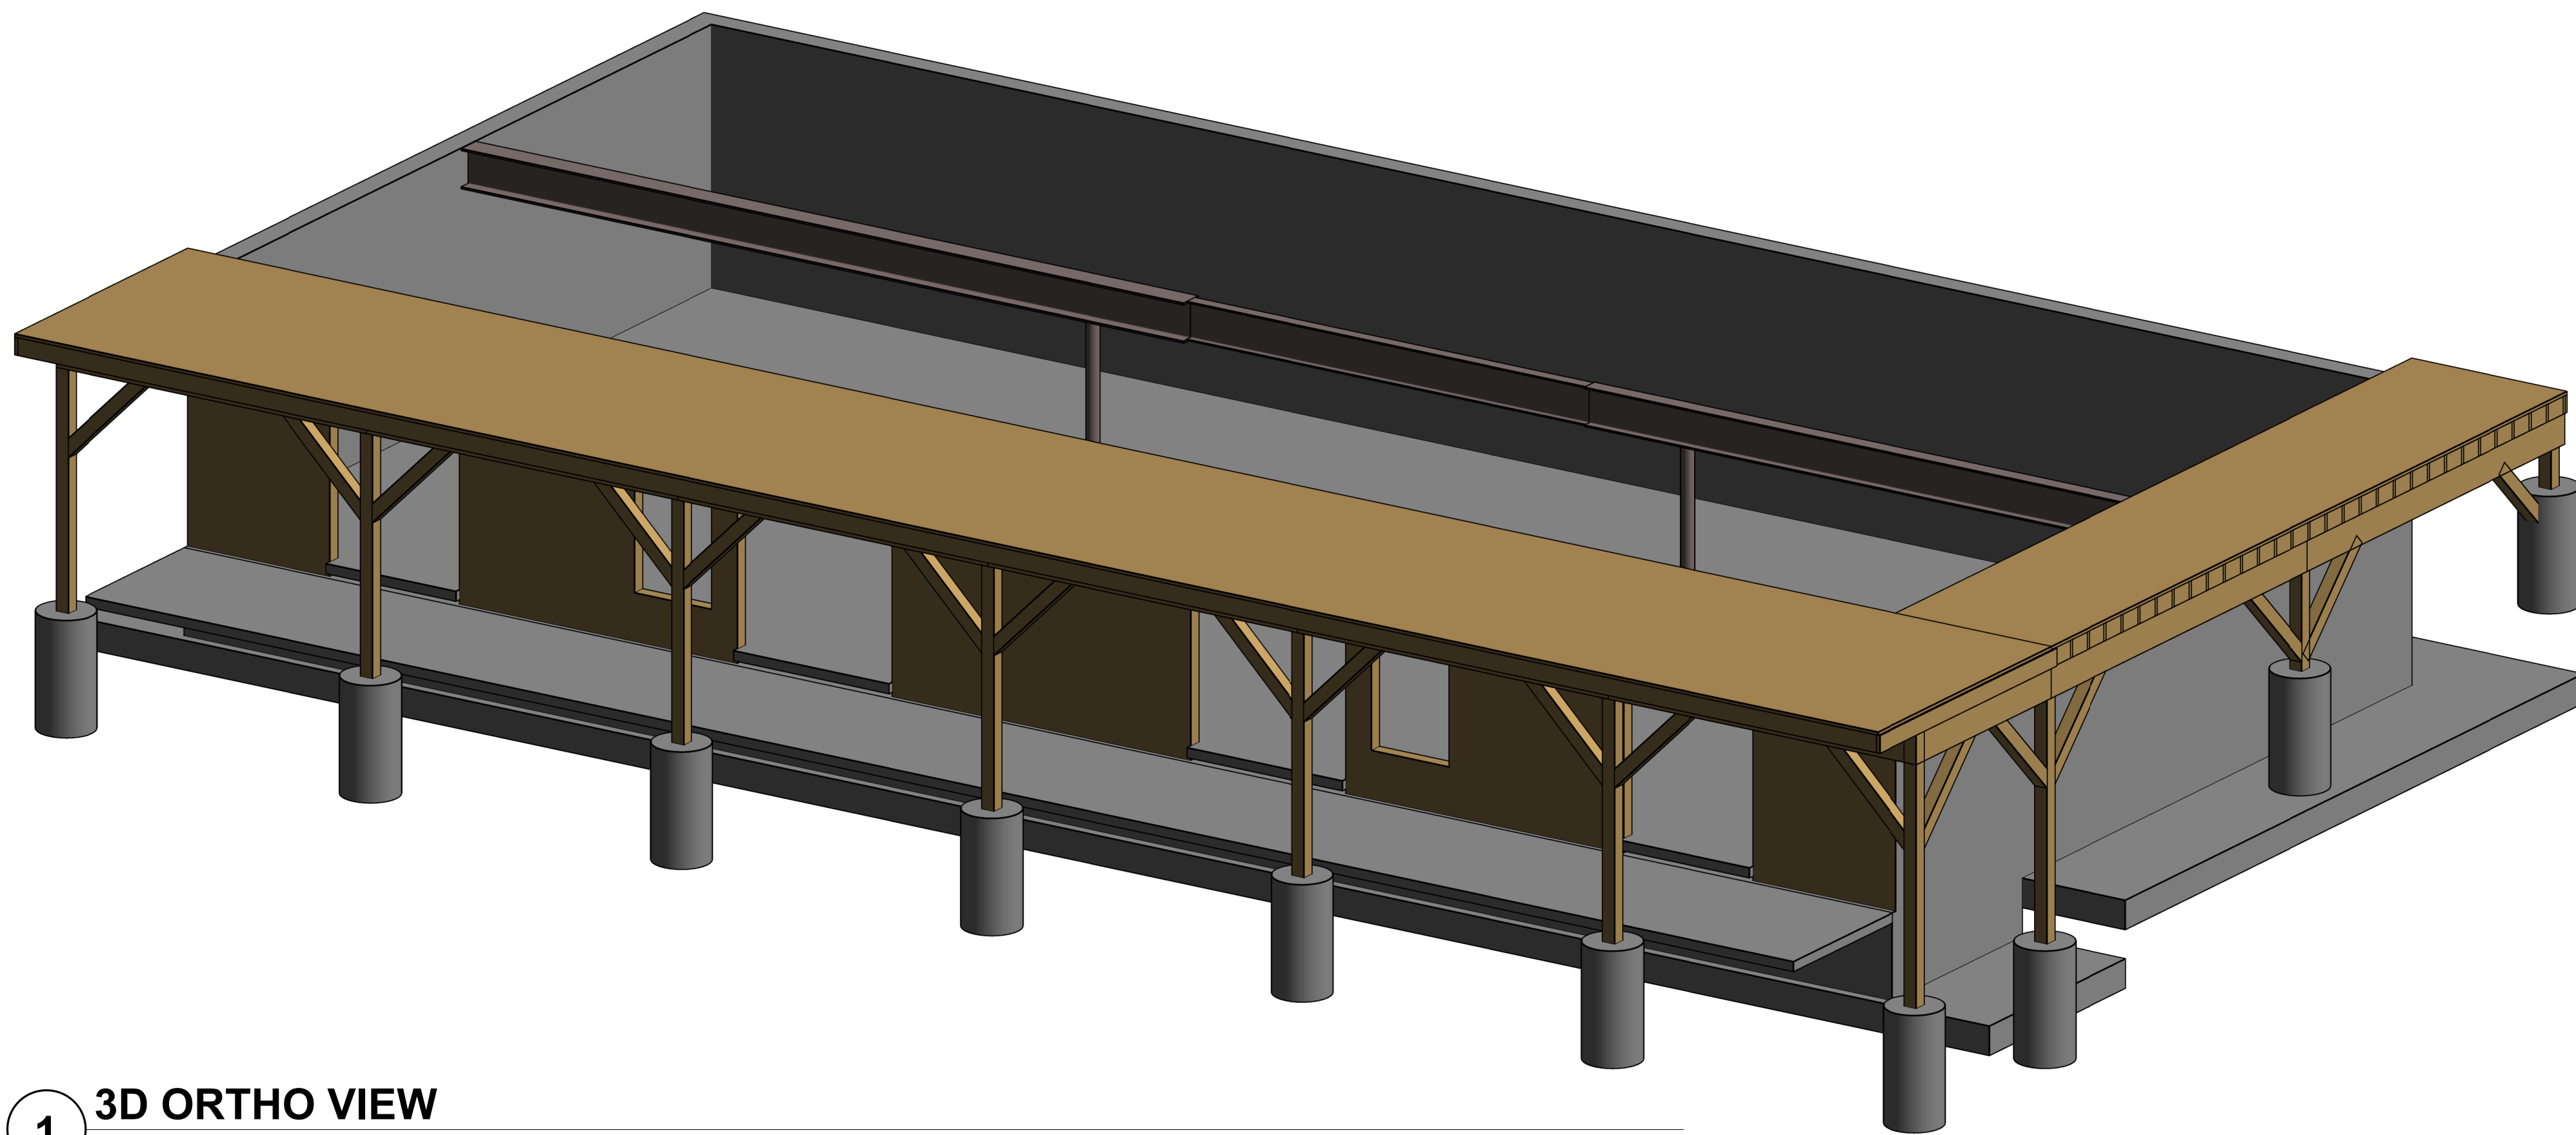

1 3D ORTHO VIEW

WOOD WALL SHEATHING SCHEDULE 10d NAILS

MARK	SHEATHING	BLOCKED EDGES	EDGE NAILING	ANCHORAGE TO FOUNDATION	PLATE WASHER REQUIRED AT BASE ANCHORS	CONNECTION AT SILL PLATE	WOOD NAILER AT STEEL	CONNECTION AT TOP PLATE	VW/OMEGA	VS/OMEGA	REMARKS
A	15/32"	YES	10d @ 6" OC	@ 24" OC	YES	16d @ 4" OC	(2) 0.177" Ø PAF @ 8" OC	SIMPSON A35 @ 18" OC	435 PLF	310 PLF	--

WOOD HOLD DOWN SCHEDULE

MARK	HOLD DOWN TYPE	INTERMEDIATE LEVEL STRAP TYPE	ANCHOR REQTS	MINIMUM STUD PACK AT HOLD DOWN	NUMBER OF PAF	REMARKS
H1	HDU2-SDS2.5	N/A	SSTB16	(2) DF #2 STUDS	11	6" MIN STEMWALL

WOOD WALL FRAMING SCHEDULE

MARK	STUD SIZE & SPACING
W6-16	2x6 DF #2 @ 16" OC

WALL FRAMING NOTES:


- SHEATHING PER SCHEDULE. STAGGER EDGES
- ALL EXTERIOR STRUCTURAL WOOD WALLS SHALL BE W6-X16, UNO
- SHEATHING TO BE APA-RATED SHEATHING. SEE TABLE IN GENERAL NOTES FOR ADDITIONAL INFORMATION.
- SHEATHING NAILS SHALL BE INSTALLED A MINIMUM OF 3/8" FROM PANEL EDGES
- SHEATHING TO BE BACKED WITH 2" NOMINAL OR WIDER MEMBERS
A. NAILS SPACED AT 3" OC OR LESS SHALL BE BACKED WITH 3" NOMINAL OR WIDER MEMBERS, INCLUDING SILL CONDITIONS.
- FIELD NAILING SHALL BE 10d NAILS @ 12" OC AT SHEATHING
- SHEATHING NAILS TO BE COMMON
- CONNECT SHEATHING DIRECTLY TO STUDS
- ALL WALL NAILING AT WALLS, INCLUDING HEADERS, BLOCKING, RIMBOARDS, ETC SHALL CONFORM TO REQUIREMENTS OF NAILING SCHEDULE IN IBC 2018, TABLE 2304.10.1 UNLESS MORE STRINGENT REQUIREMENTS ARE SHOWN IN DRAWINGS.

HOLD DOWN NOTES:

- HOLD DOWN LOCATIONS AS SHOWN ON PLAN
- INSTALL ALL HOLD DOWNS AND HOLD DOWN ANCHORS PER MNFR'S WRITTEN INSTRUCTIONS
- MINIMUM HOLD DOWN ATTACHMENT TO BE (2) 2x WALL STUD THICKNESS, UNLESS NOTED OTHERWISE


4 EAST ELEVATION

1/4" = 1'-0"

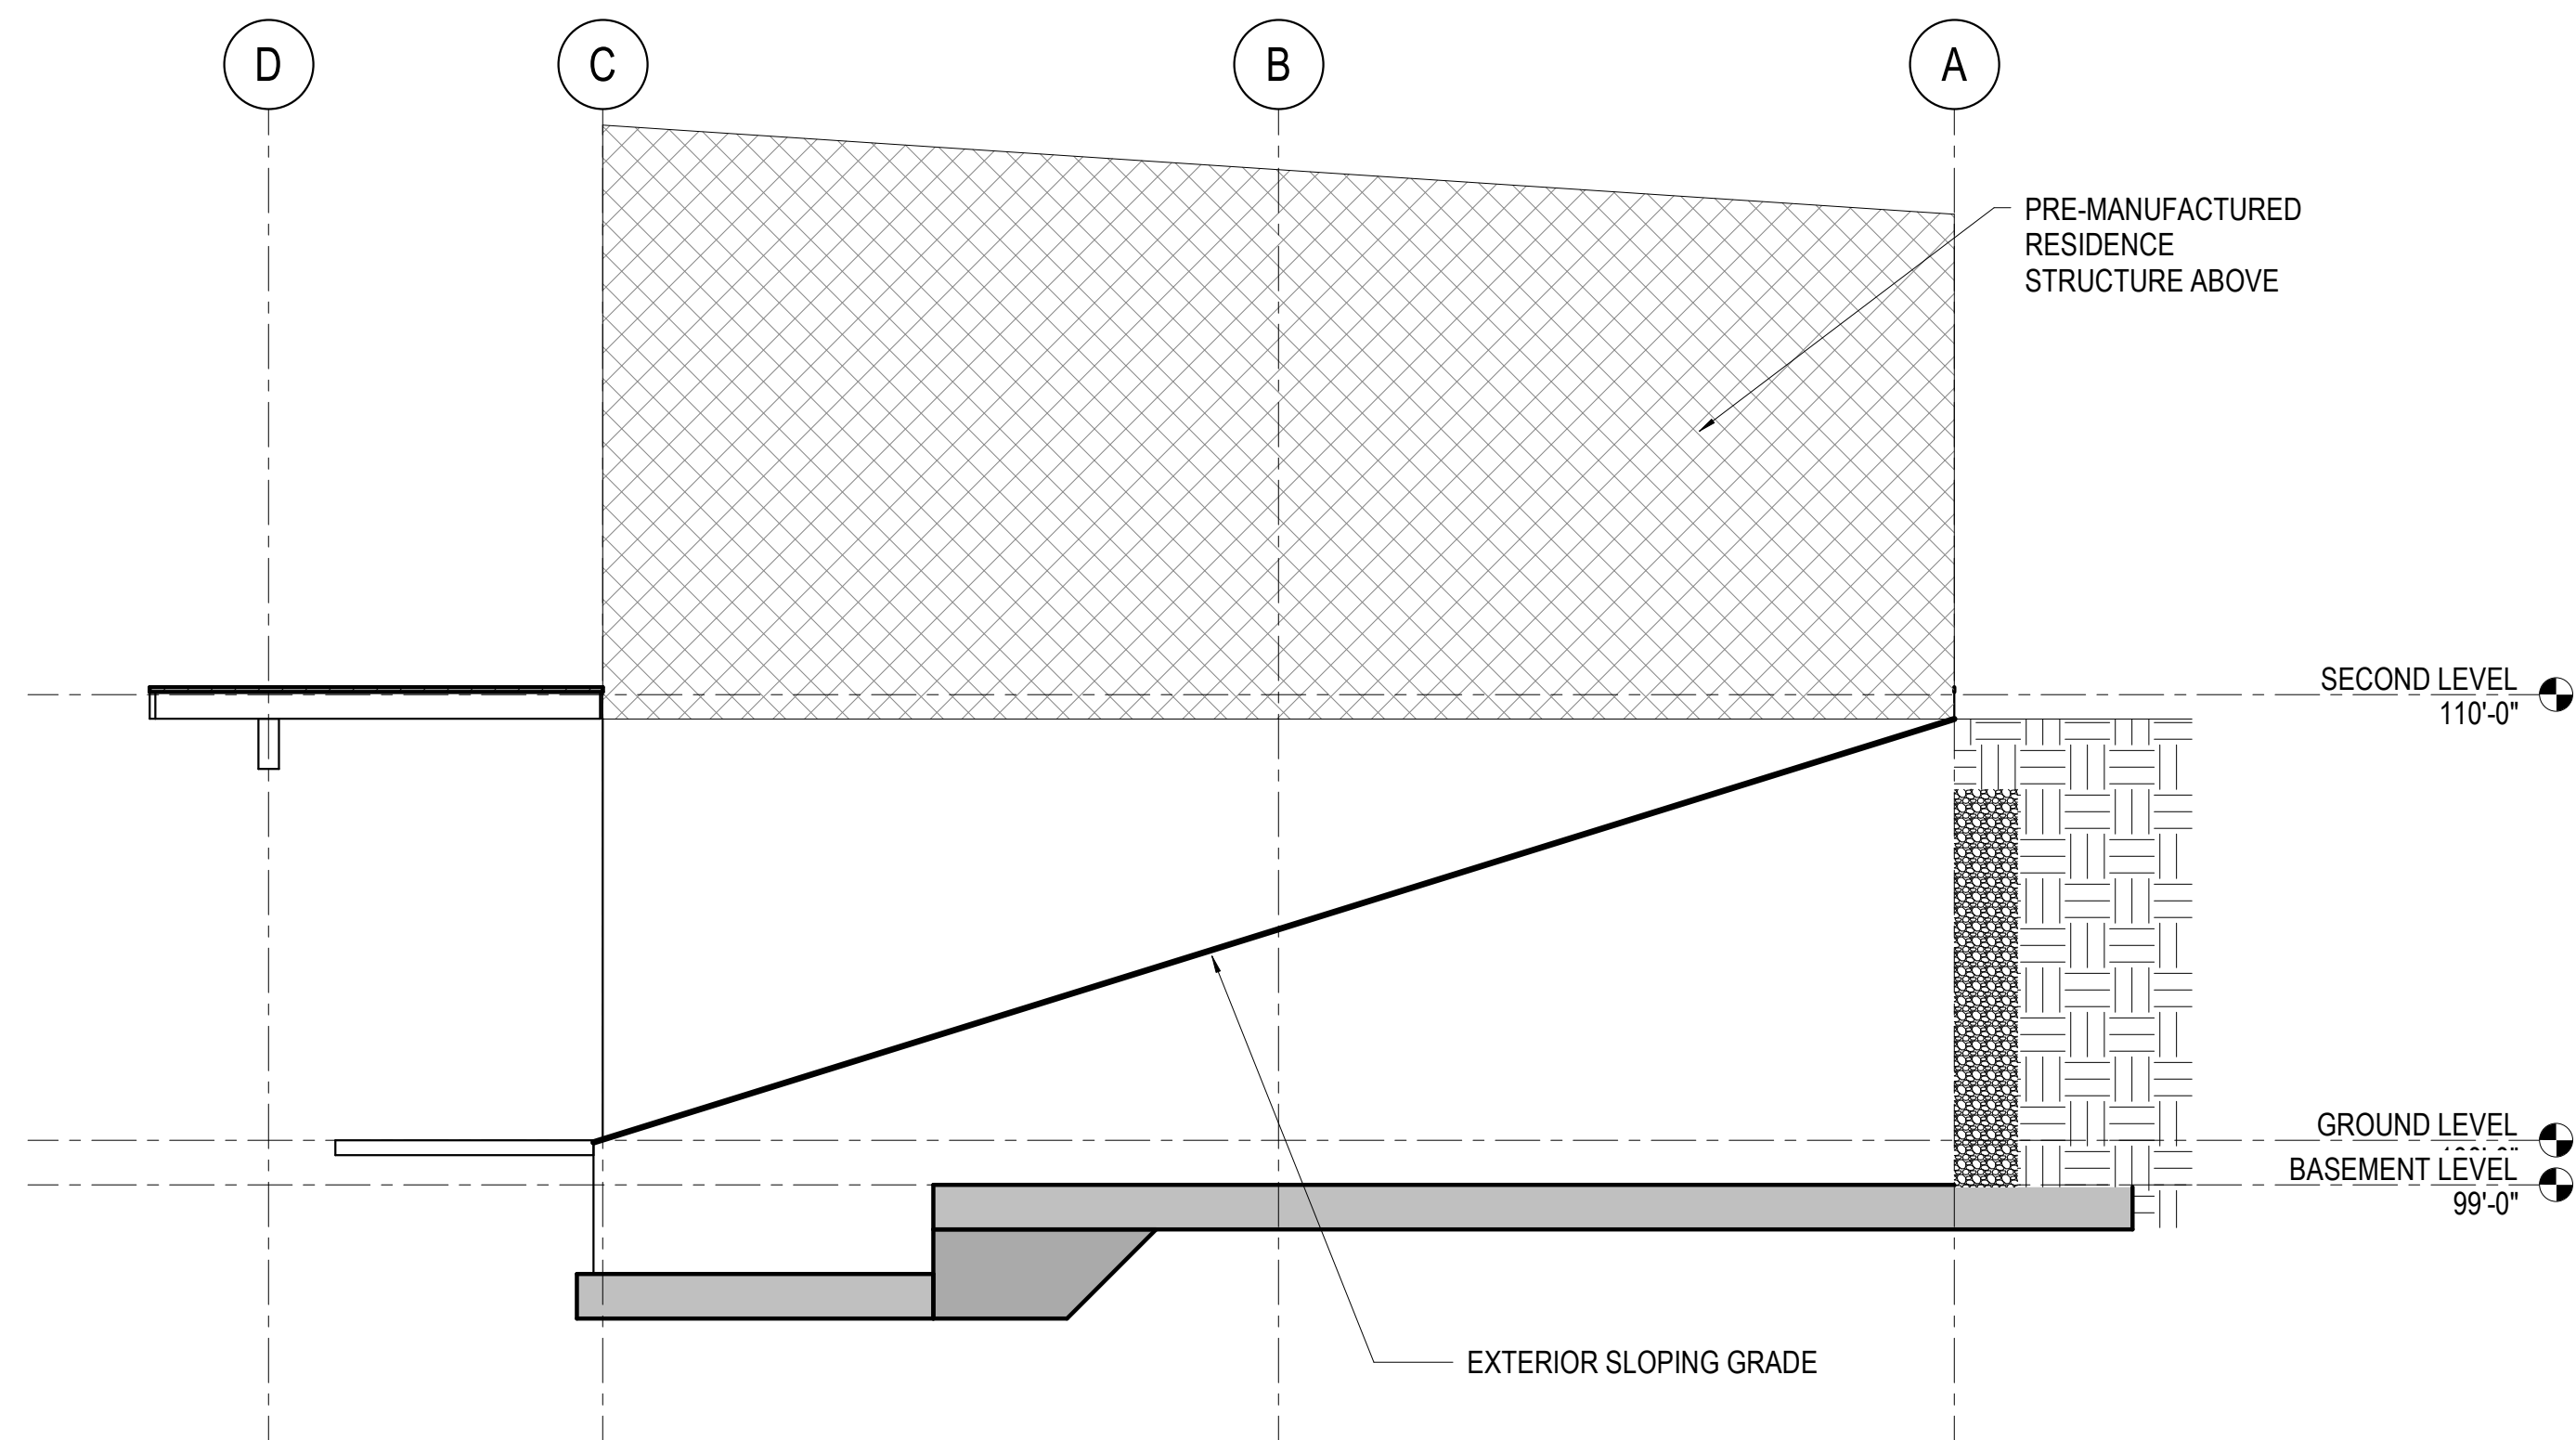


5 WEST ELEVATION

1/4" = 1'-0"

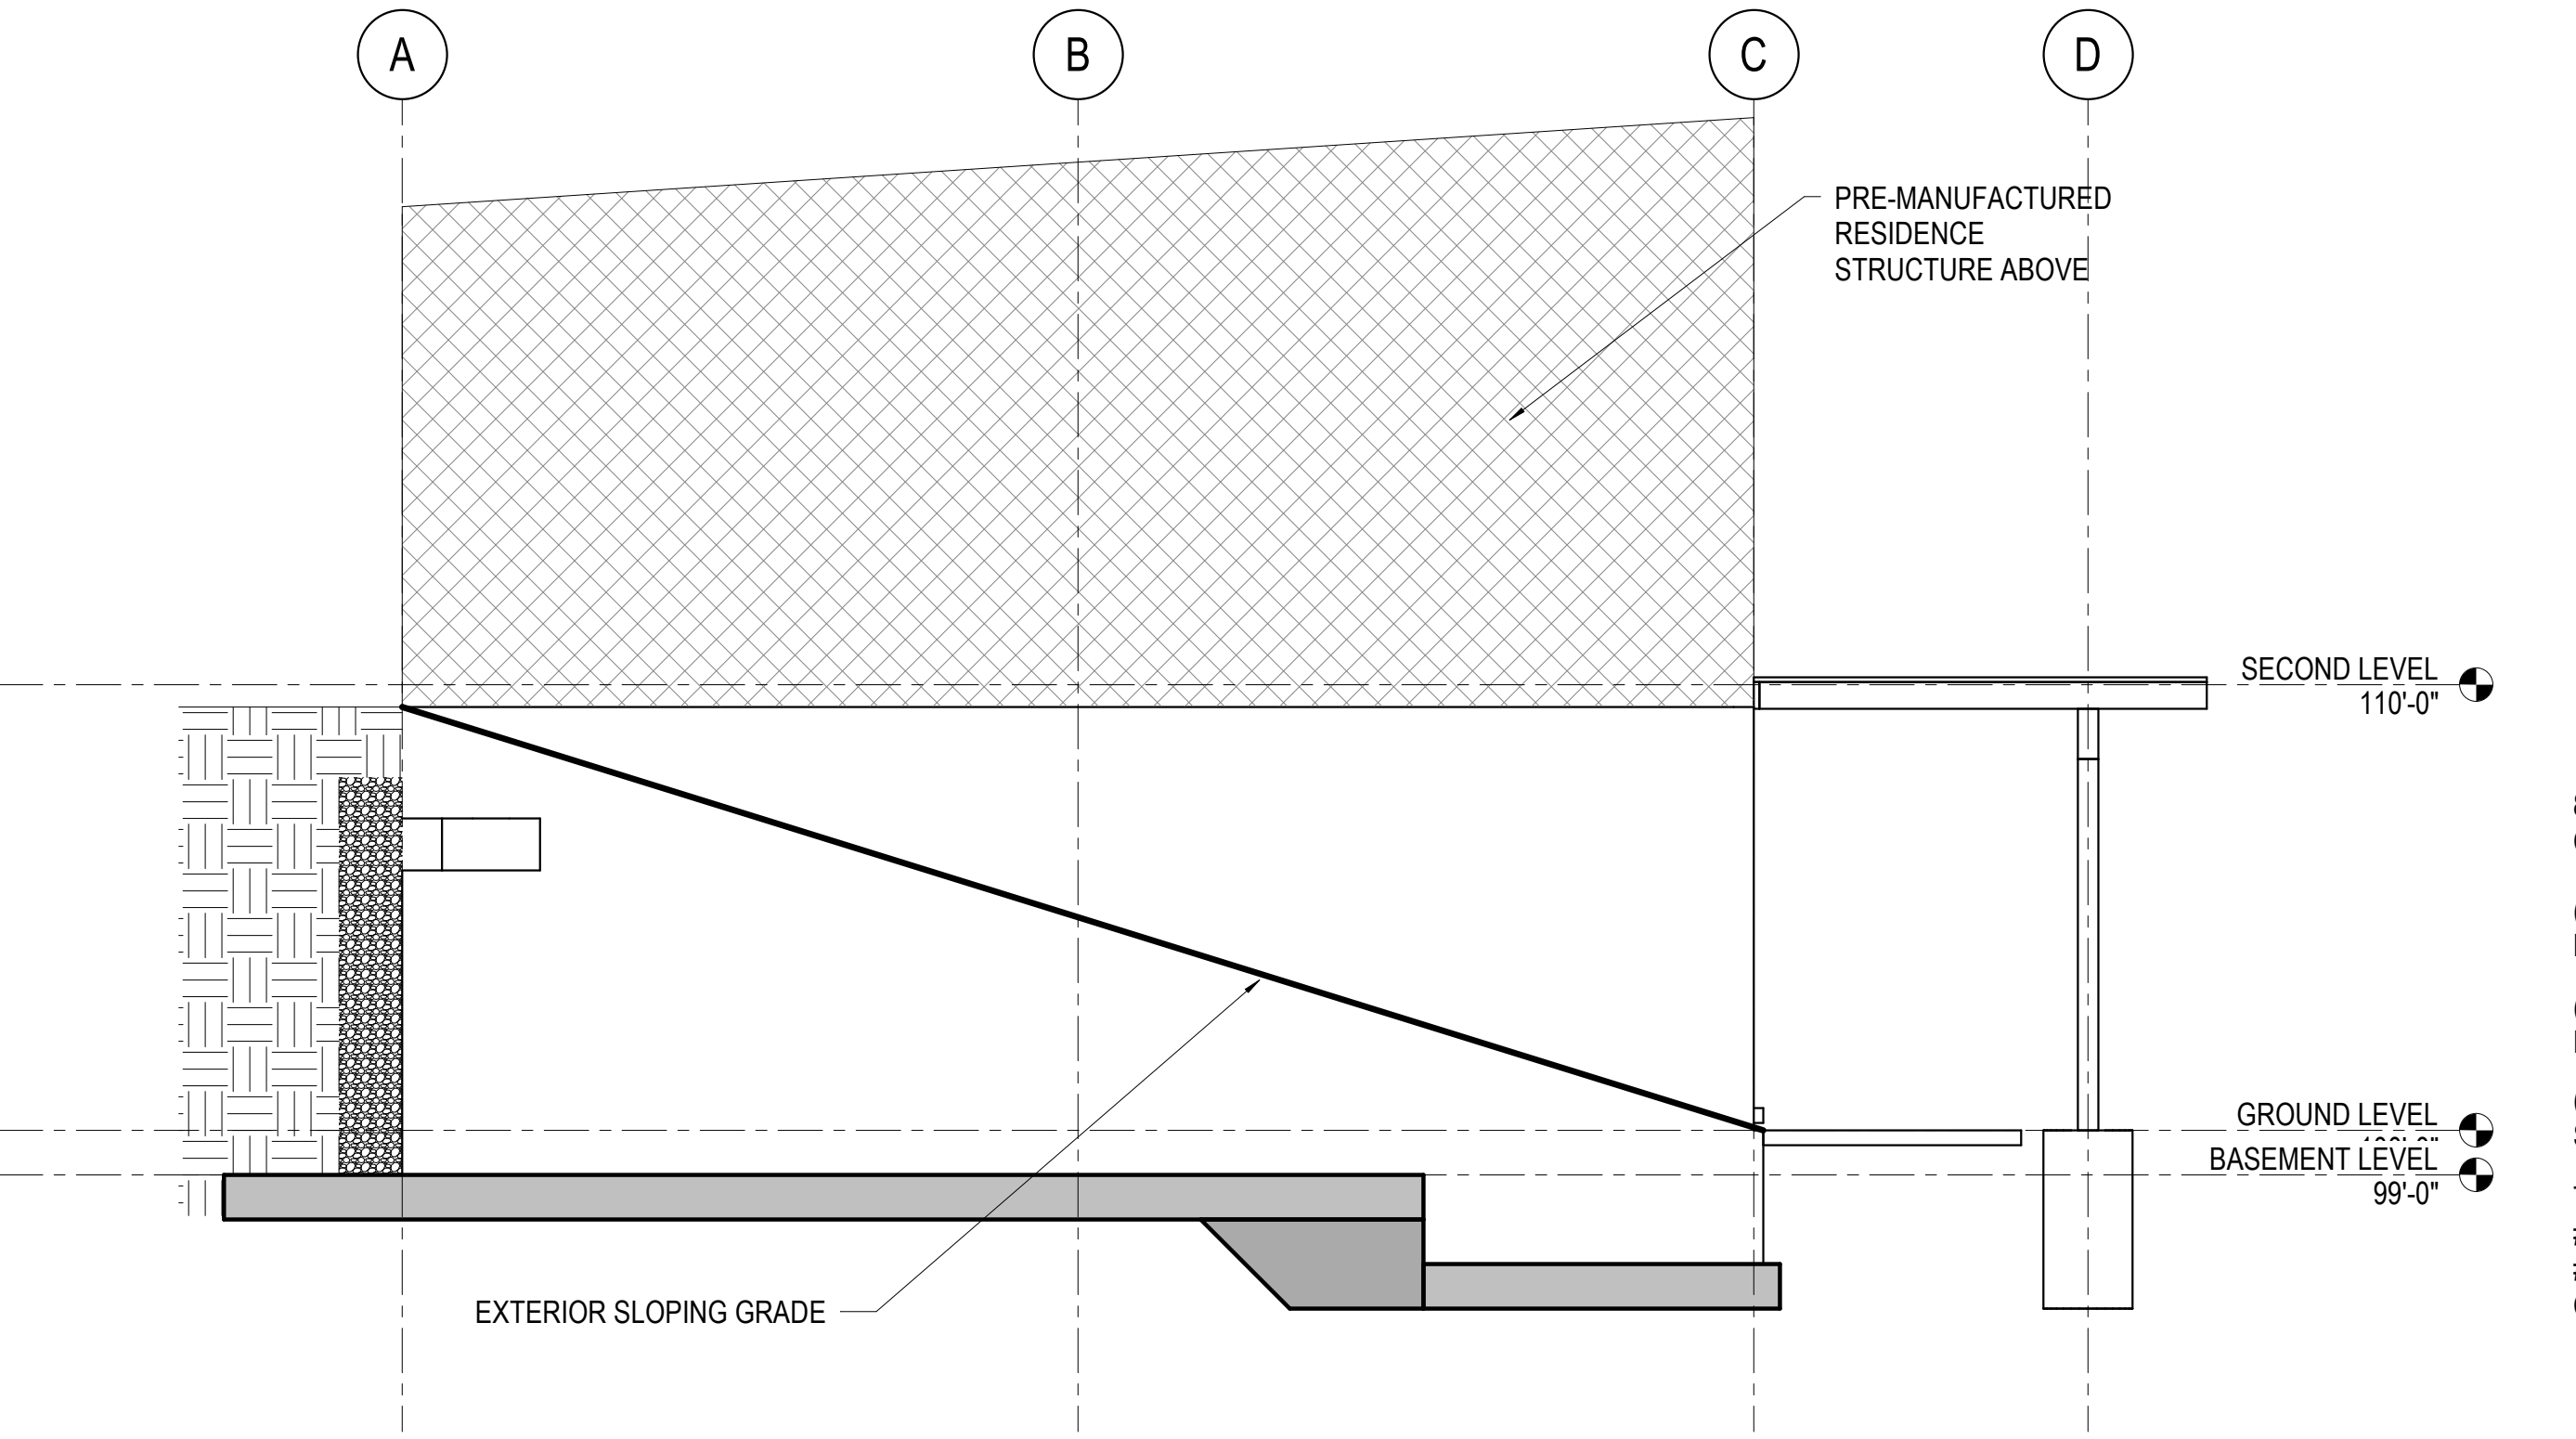

2 SOUTH ELEVATION AND WALL FRAMING NOTES

1/4" = 1'-0"

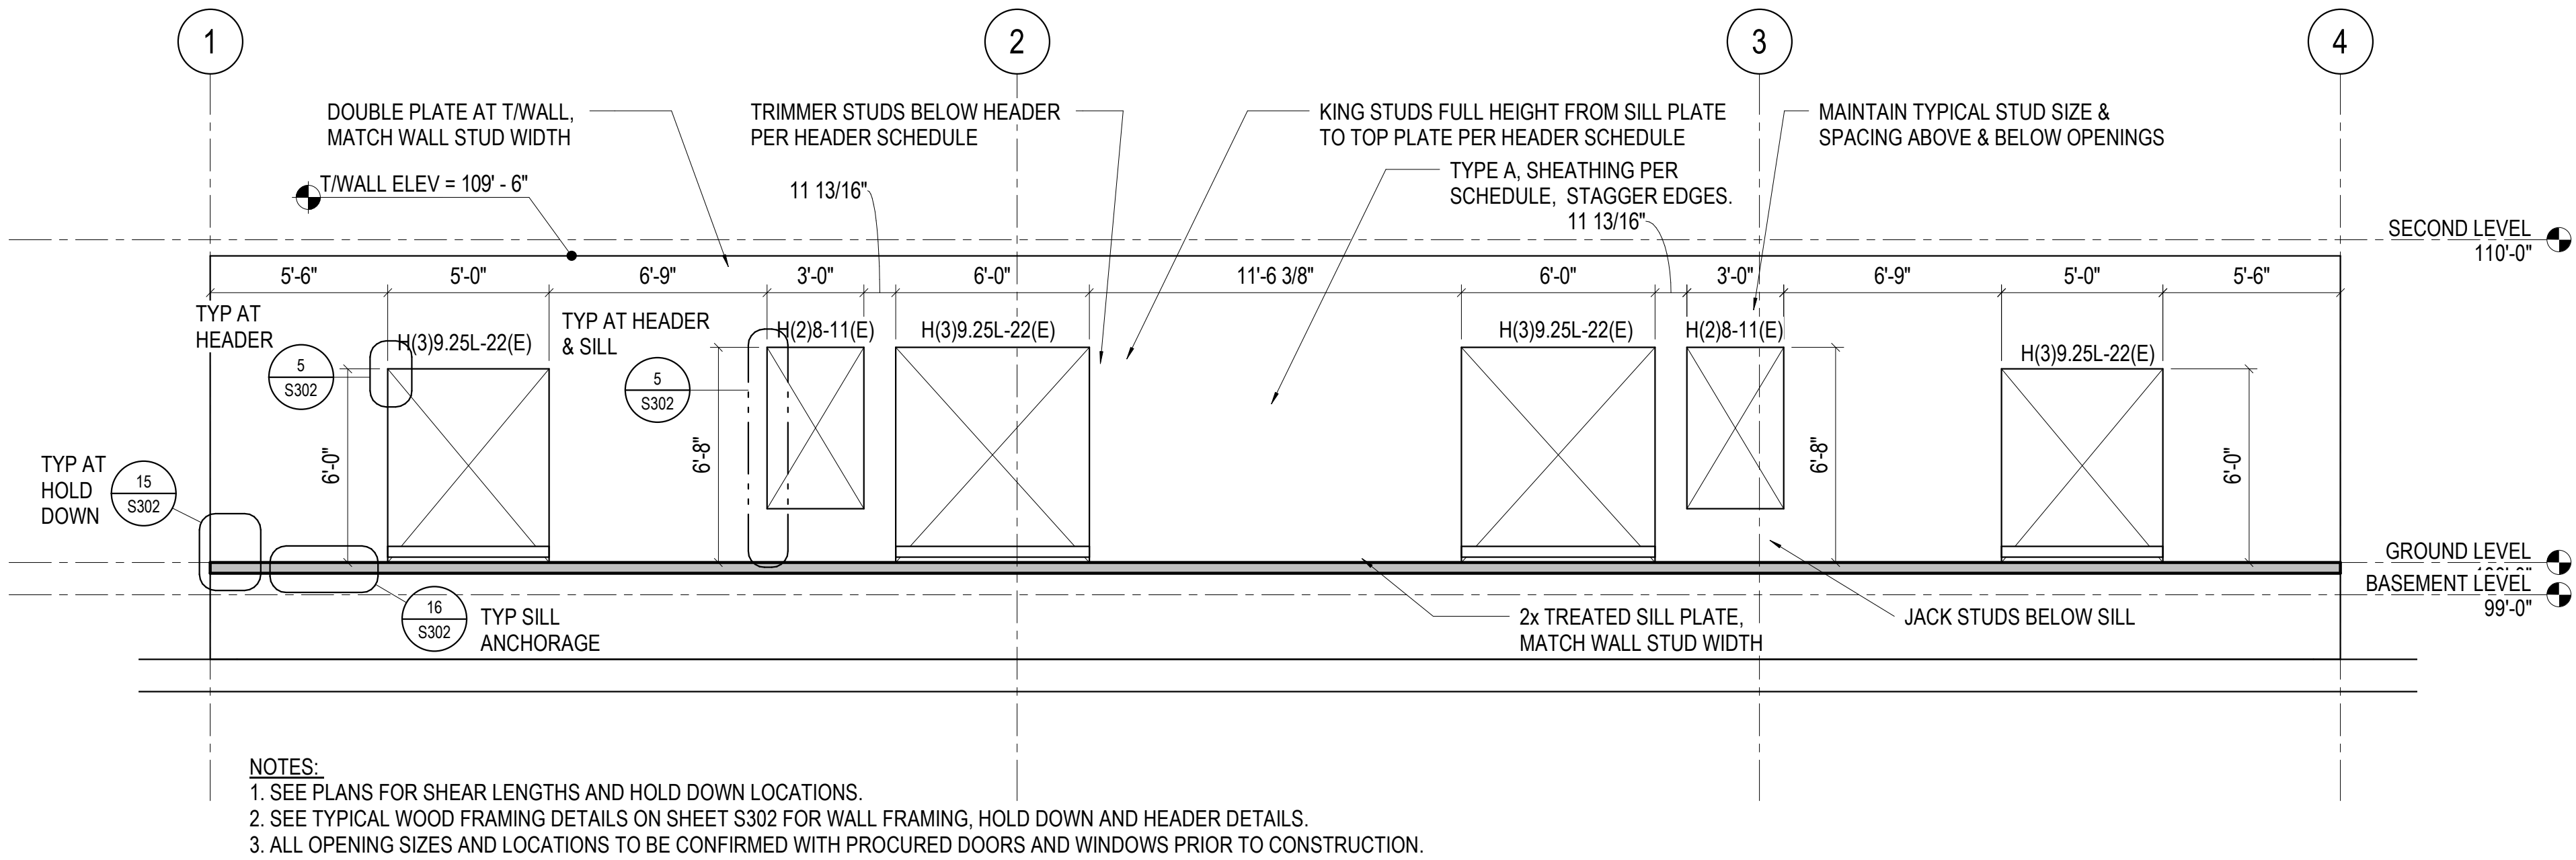

3 SOUTH ELEVATION AND WALL FRAMING NOTES

1/4" = 1'-0"

